


NOTES:

1. CONSULT WITH CITY ENGINEER IN LOCATIONS WHERE EXISTING CONDITIONS PREVENT BACK OF SIDEWALK CURVATURE.
2. CONSULT WITH CITY ENGINEER IN LOCATIONS WHERE 12" MINIMUM WIDTH BETWEEN STREET TREE AND SIDEWALK IS NOT FEASIBLE.
3. MAINTAIN MINIMUM 3' OF PLANTER SPACE BETWEEN STREET TREE AND EXISTING CONDITIONS. REMOVE EXISTING ASPHALT OR CONCRETE IF PRESENT. DO NOT ALTER DRIVEWAY OR CURB RAMP IF WITHIN 3' OF STREET TREE UNLESS APPROVED BY CITY ENGINEER.
4. FOR ADDITIONAL REQUIREMENTS, SEE ST 4.0
5. CONSULT WITH CITY ENGINEER WHERE PLANTER WIDTH IS LESS THAN 4'
6. CONSULT WITH CITY ENGINEER WHERE SIDEWALK WIDTH IS LESS THAN 4'.

SCALE: 1/4"=1'-0"



CITY OF ALBANY, CALIFORNIA


STANDARD

APPROVED BY: *Mal V. Bailey*

DATE: MARCH 2022

**SIDEWALK (WHERE WIDTH \geq 4 FT & < 5FT)
CURVATURE AROUND STREET TREE**


STD DETAIL No.
ST 4.1

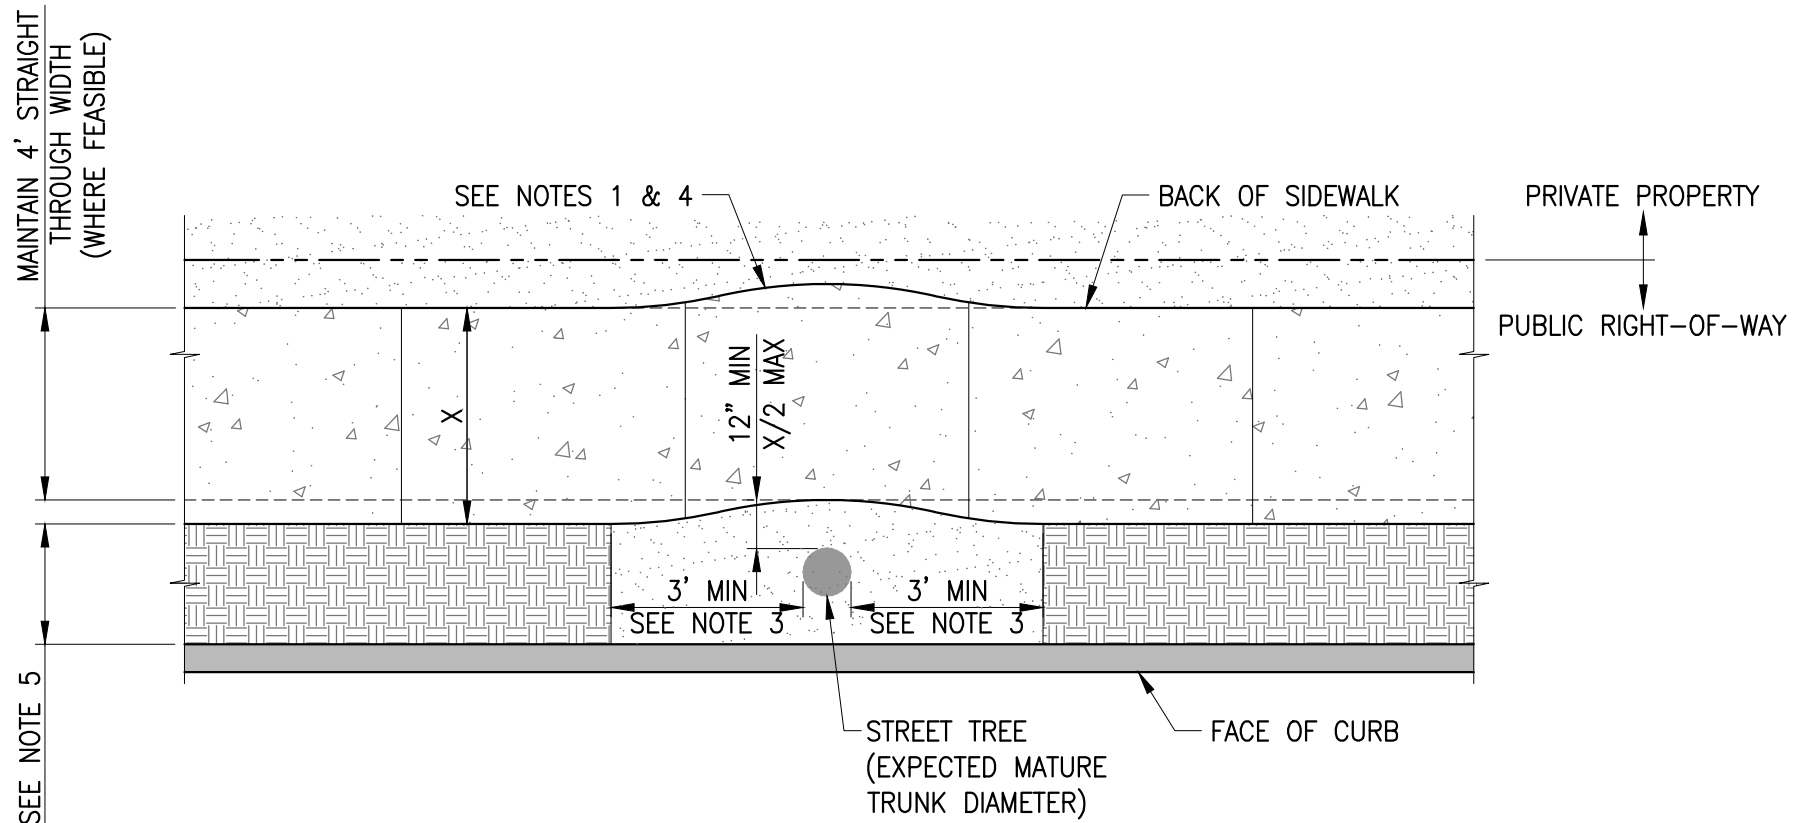

NOTES:

1. CONSULT WITH CITY ENGINEER IN LOCATIONS WHERE EXISTING CONDITIONS PREVENT BACK OF SIDEWALK CURVATURE.
2. CONSULT WITH CITY ENGINEER IN LOCATIONS WHERE 12" MINIMUM WIDTH BETWEEN STREET TREE AND SIDEWALK IS NOT FEASIBLE.
3. MAINTAIN MINIMUM 3' OF PLANTER SPACE BETWEEN STREET TREE AND EXISTING CONDITIONS. REMOVE EXISTING ASPHALT OR CONCRETE IF PRESENT. DO NOT ALTER DRIVEWAY OR CURB RAMP IF WITHIN 3' OF STREET TREE UNLESS APPROVED BY CITY ENGINEER.
4. FOR ADDITIONAL REQUIREMENTS, SEE ST 4.0
5. CONSULT WITH CITY ENGINEER WHERE PLANTER WIDTH IS LESS THAN 4'

SCALE: 1/4"=1'-0"



CITY OF ALBANY, CALIFORNIA

STANDARD

APPROVED BY: *Mal V. Dwyer*
DATE: MARCH 2022

**SIDEWALK (WHERE WIDTH ≥ 5FT)
CURVATURE AROUND STREET TREE**

STD DETAIL No.
ST 4.2